

**Southern Westchester BOCES**

**Districtwide Lead in Drinking Water  
Sampling and Remediation Plan**

**2020**



**ENVIROSCIENCE**  
**CONSULTANTS INC.**

**2150 Smithtown Avenue  
Ronkonkoma, NY 11779  
(631) 580-3191  
[www.envirohealth.org](http://www.envirohealth.org)**

**Project #20296**

**Districtwide Lead in Drinking Water  
Sampling and Remediation Plan**

**Performed for:**

**Southern Westchester BOCES  
17 Berkley  
Rye Brook, NY 10573**

**October 2020**

**Prepared by:**

**Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779  
(631) 580-3191**

**Project #20296**

**President**



---

**Glenn Neuschwender**

# **Districtwide Lead in Drinking Water Sampling and Remediation Plan**

## **Table of Contents**

### **I. Executive Summary**

### **II. Sampling Methodology**

### **III. Initial Results**

**Appendix A – Adult Training Facility-450 Mamaroneck Avenue**

**Appendix B – Rye Brook Administration Building**

**Appendix C – Rye Lake Campus**

**Appendix D – St. Matthew’s School**

**Appendix E – Valhalla VTE Campus**

December 1, 2020

Thomas Briggs  
Southern Westchester BOCES  
17 Berkley Drive  
Rye Brook, NY 10573

## **I. Executive Summary**

The Southern Westchester BOCES district has developed their 2020 Lead in Drinking Water Sampling and Analysis Program, as required by the New York State Department of Health (Public Health Law Sections 1370-a and 1110, Subpart 67-4 Lead Testing in School Drinking Water).

In accordance with the regulation, this Lead Remediation Plan is prepared to identify locations deemed as Applicable Drinking Water Sources and report first draw sample results, to mitigate locations where sample results exceed 15 parts per billion, to identify locations deemed as Non-Applicable Water Sources, communicate this designation to building occupants, and to develop strategies for monitoring locations deemed Non-Applicable Water Sources to insure building occupants do not consume water from these locations.

Within the Southern Westchester BOCES district, the following locations have been deemed Applicable Drinking Water Sources by the administration:

- 1) Water fountains and bottle filling stations;
- 2) Kitchen water faucets and pot fillers used in food preparation;
- 3) Ice machines
- 4) Elementary School classroom sinks
- 5) Elementary School bathroom sinks

First draw samples were collected from each of these locations within the District, and analyzed by a New York State Department of Health ELAP certified laboratory. For results at or below 15 ppb, no further action is required until 2025. For locations above 15 ppb, options include: second and third draw sample collection to determine source of lead, designation of the location as Non-applicable Water Source, or permanent removal of the fixture from the location. In either case, the result was communicated by Enviroscience Consultants, and the fixture was shut off by the District immediately upon receipt of results.

The following locations within the Southern Westchester BOCES district were deemed Non-Applicable Water Sources by the administration:

- 1) Science Laboratory/Technical Shop sinks;
- 2) Art Room sinks;
- 3) Other classroom sinks;
- 4) Other Bathroom sinks;
- 5) Outside spigots
- 6) Custodial Closet sinks

In these cases, the District has placed signs adjacent to the fixture to notify occupants that the water is not intended for consumption. To further support this protocol, the following management of the locations is required:

- 1) Science Laboratory/Technical Shop sinks - communicate in writing with students that these locations are for science experiments and hand washing only, not for consumption. This is most easily accomplished by including this language in the laboratory safety paperwork distributed to students at the beginning of the school year. This program should be monitored by the respective science teachers, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 2) Art Room sinks - communicate in writing to students that these locations are for cleaning of art supplies and hand washing only, not for consumption. This is most easily accomplished by including this language in the course paperwork distributed to students at the beginning of the school year. This program should be monitored by the respective art teachers, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 3) Other classroom sinks - classrooms in this category, where students are to hand wash after bathroom usage or instructional activities as part of a regular hygiene program. This program should be monitored by teachers and staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 4) Bathroom sinks - in intermediate buildings, signage should be sufficient for communicating the concept of hand washing only. In elementary schools, personal hygiene should be integrated into curriculum to ensure students understand bathroom sinks are for hand washing only, and not consumption. Further, show what the signage looks like in bathrooms so they learn to recognize its meaning. This program should be monitored by teachers and staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 5) Outside spigots - all-weather signage will be installed at each location. Further, spigots will have a special key maintained by the custodial staff to ensure that non-authorized persons do not fill sports coolers or use hoses for consumption. This program should be monitored by custodial staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 6) Custodial Closet sinks - these locations should be accessed by custodial personnel only, and locked when not in use. Access to others should be restricted. This program should be monitored by custodial staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.

## **II. Sampling Procedures:**

In accordance with the regulation, EnviroScience Consultants, Inc. performed initial water sampling throughout the Southern Westchester BOCES district on October 29 and 30, 2020. Samples were collected in wide-mouth 250 milliliter containers and were collected in the morning hours before the facilities opened. The water sources were not used for at least 8 hours and not more than 18 hours prior to sampling. Unique source numbers and designations were assigned to each source location. Unique sample identification numbers were assigned to each sample taken. The key to fixture type codes and the sampling location schematics are shown below.


### **Fixture Type Codes**

BF	Bottle Filler
HB	Hose Bib
IM	Ice Machine
OS	Other Source
PF	Pot Filler
SK	Sink
SL	Supply Line
SP	Spigot
SPY	Spray
SS	Slop Sink
V	Valve
WC	Water Cooler
WF	Water Fountain

### **Source Designations**

App	Applicable
N/A	Non-applicable

## Sampling Location Schematics

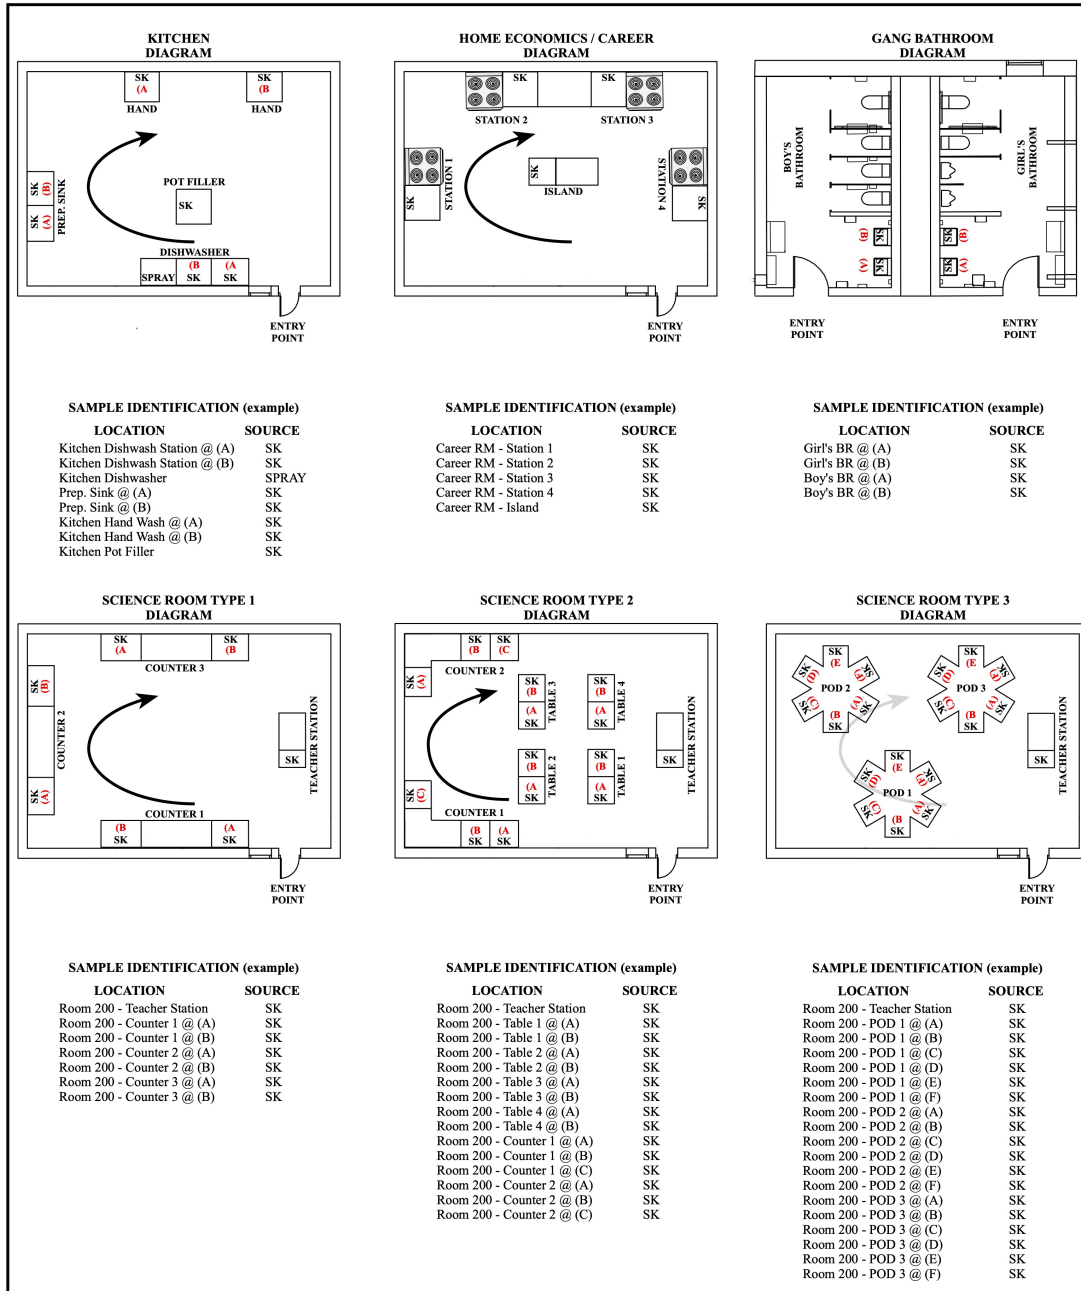

### III. Initial Results:

All water source locations in each of the school buildings were assessed. Water source locations identified as drinking water sources were considered Applicable, and first draw samples were collected. Water source locations identified as non-drinking water sources were considered Non-applicable and these locations were documented.

The results of the initial sampling and the use of signs warning against water use at Non-applicable sources is documented in the School Water Outlet Inventory for each building (Appendix A through D).

All elevated locations should be taken off line until the remediation is completed. Any other drinking water sources in these buildings that were not functional at the time of initial sampling and have not been tested should be tested. All locations deemed non-applicable, but do not have signs, should be taken off line until signs have been posted.

The following is a summary of results in parts per billion (ppb) of locations where sample results were found above 15 ppb:

#### Adult Training Center at 450 Mamaroneck Avenue

Pantry/Lounge 346	SK	30.3
Room 217 Nursing Lab-right	SK	18

#### Rye Lake Campus

Building 2 Room 138	SK	15.8
Building 2 Room 140	SK	35.7
Building 2 Room 141	SPY	254
Building 2 Main Lobby Women's Bathroom	SK	60.1
Building 2 Room 116	SPY	137
Building 2 Room 118	SK	117
Building 2 Second Floor Women's Bathroom (right)	SK	23.3
Building 2 Conference Room Kitchenette	SK	227
Building 2 Conference Room Kitchenette	SPY	252
Building 1 Principal's Office Kitchenette	SK	18.4



### Rye Lake Campus (continued)

Building 1 Room 8 Life Skills (lower sink)	SK	20.3
Building 1 Room 15	SK	23.4
Building 1 Room 19	SK	31.3
Building 1 Room 21	SK	27.3
Building F Staff Bathroom	SK	36.7
Building B Bathroom	SK	23.9

### Valhalla CTE Campus

B-108 Kitchenette	SK	215
Girls Bathroom by B-108 @ A	SK	52.7
B-102	SK	29.7
B-101 Storage Room	SK	62.4
Building B Mezzanine Kitchenette	SK	16
D-304	SK	47
Boys Bathroom @B between Room E101 & E102	SK	56.2

## Appendix A

School Water Outlet Inventory

Lead in School Drinking Water Program 2020

Space #	Sample Location	Fixture Type	App or N/A	Latest 1 <sup>st</sup> Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remedial Recommendation	Remedial Response	Post Remedial Results (ppb)	Post Remedial Sampling Date
1001-1	Pantry/Lounge 408	SK	App	<1.0	10/30/2020	-	-	-	None	-	-	-
1001-2	Pantry/Lounge 408	SPY	App	<1.0	10/30/2020	-	-	-	None	-	-	-
1002-1	Men's Bathroom by Pantry/Lounge 427 @A	SK	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
1002-2	Men's Bathroom by Pantry/Lounge 427 @B	SK	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
1003-1	Women's Bathroom by Pantry/Lounge 427 @A	SK	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
1003-2	Women's Bathroom by Pantry/Lounge 427 @B	SK	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
1004-1	Pantry/Lounge 427	SK	App	<1.0	10/30/2020	-	-	-	None	-	-	-
1004-2	Pantry/Lounge 427	SPY	App	<1.0	10/30/2020	-	-	-	None	-	-	-
1005-1	Women's Bathroom by Room 319 @A	SK	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
1005-2	Women's Bathroom by Room 319 @B	SK	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
1005-3	Women's Bathroom by Room 319 @C	SK	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
1005-4	Women's Bathroom by Room 319 @D	SK	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
1005-5	Women's Bathroom by Room 319 @E	SK	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
1005-6	Women's Bathroom by Room 319 @F	SK	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
1006-1	Men's Bathroom by Room 319 @A	SK	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
1006-2	Men's Bathroom by Room 319 @B	SK	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
1006-3	Men's Bathroom by Room 319 @C	SK	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
1006-4	Men's Bathroom by Room 319 @D	SK	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
1006-5	Men's Bathroom by Room 319 @E	SK	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
1006-6	Men's Bathroom by Room 319 @F	SK	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-

Action Level = 15.0 parts per billion (ppb) (µg/L)

Southern Westchester BOCES  
Adult Training Facility-450 Mamaroneck Avenue

School Water Outlet Inventory

Lead in School Drinking Water Program 2020

Space #	Sample Location	Fixture Type	App or N/A	Latest 1 <sup>st</sup> Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remedial Recommendation	Remedial Response	Post Remedial Results (ppb)	Post Remedial Sampling Date
1007-1	Pantry/Lounge 346	SK	App	30.3	10/30/2020				Additional Sampling Required			
1007-2	Pantry/Lounge 346	SPY	App	3.87	10/30/2020	-	-	-	None	-	-	-
2001-1	Second Floor Student Lounge	SK	App	<1.0	10/30/2020	-	-	-	None	-	-	-
2002-1	Bathroom by Second Floor Elevator Lobby @ A	0	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
2002-2	Bathroom by Second Floor Elevator Lobby @ B	0	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
2002-3	Bathroom by Second Floor Elevator Lobby @ C	0	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
2002-4	Bathroom by Second Floor Elevator Lobby @ D	0	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
2002-5	Bathroom by Second Floor Elevator Lobby @ E	0	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
2002-6	Bathroom by Second Floor Elevator Lobby @ F	0	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
2003-1	Room 215 Medical Training-right	SK	App	6.17	10/30/2020	-	-	-	None	-	-	-
2003-2	Room 215 Medical Training-left	SK	App	9.87	10/30/2020	-	-	-	None	-	-	-
2004-1	Room 217 Nursing Lab-right	SK	App	18	10/30/2020				Additional Sampling Required			
2004-2	Room 217 Nursing Lab-left	SK	App	11.7	10/30/2020	-	-	-	None	-	-	-
2005-1	Room 224 Nursing Assistant Training Room	SK	App	5.03	10/30/2020	-	-	-	None	-	-	-
2006-1	Men's Bathroom by Room 224 @ A	SK	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
2006-2	Men's Bathroom by Room 224 @ B	SK	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
2006-3	Men's Bathroom by Room 224 @ C	SK	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
2007-1	Women's Bathroom by Room 224 @ A	SK	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
2007-2	Women's Bathroom by Room 224 @ B	SK	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-
2007-3	Women's Bathroom by Room 224 @ C	SK	N/A		10/30/2020	-	-	-	Mixed Valve Sampling Not Required	-	-	-

Action Level = 15.0 parts per billion (ppb) (µg/L)

**Laboratory Report**

NYE Report #: 2204365-16051

November 3, 2020

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: 450 Mamaroneck Adult Training Facility

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on October 30, 2020. New York Environmental analyzed the samples on October 31, 2020 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	30 Oct 2020
Date Received:	30 Oct 2020
Date Analyzed:	31 Oct 2020

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
201030P066	1	Pantry/Lounge 427-SK; Initial	1.00	<1.00	µg/L	
201030P067	2	Pantry/Lounge 427-SPY; Initial	1.00	<1.00	µg/L	
201030P068	3	Pantry/Lounge 408-SK; Initial	1.00	<1.00	µg/L	
201030P069	4	Pantry/Lounge 408-SPY; Initial	1.00	<1.00	µg/L	
201030P070	5	Pantry/Lounge 346-SK; Initial	1.00	30.3	µg/L	H
201030P071	6	Pantry/Lounge 346-SPY; Initial	1.00	3.87	µg/L	
201030P072	7	Second Floor Student Lounge-SK; Initial	1.00	<1.00	µg/L	
201030P073	8	Room 215 Medical Training-right-SK; Initial	1.00	6.17	µg/L	
201030P074	9	Room 215 Medical Training-left-SK; Initial	1.00	9.87	µg/L	
201030P075	10	Room 217 Nursing Lab-right-SK; Initial	1.00	18.0	µg/L	H
201030P076	11	Room 217 Nursing Lab-left-SK; Initial	1.00	11.7	µg/L	
201030P077	12	Room 224 Nursing Assistant Training Room-SK; Initial	1.00	5.03	µg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.



## Appendix B

**Southern Westchester BOCES  
Rye Brook Administration Building**

**School Water Outlet Inventory**

**Lead in School Drinking Water Program 2020**

Space #	Sample Location	Fixture Type	App or N/A	Latest 1 <sup>st</sup> Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remedial Recommendation	Remedial Response	Post Remedial Results (ppb)	Post Remedial Sampling Date
1000	Main Lobby	WF	App		10/30/2020	-	-	-	None	Removed from Service	-	-
1001-1	Kitchen	SK	App	1.32	10/30/2020	-	-	-	None	-	-	-
1002	Staff Restroom - First Floor	SK	N/A		10/30/2020	-	-	-	Sign Required	-	-	-
1003	Staff/Guest Bathroom - First Floor	SK	N/A		10/30/2020	-	-	-	Sign Required	-	-	-
1004	Slop Sink - Basement	SK	N/A		10/30/2020	-	-	-	Sign Required	-	-	-
1005	Room 201 Bathroom	SK	N/A		10/30/2020	-	-	-	Sign Required	-	-	-
1006	Room 204 Bathroom	SK	N/A		10/30/2020	-	-	-	Sign Required	-	-	-
1007	Room 207 Bathroom	SK	N/A		10/30/2020	-	-	-	Sign Required	-	-	-
1008	Ladies Room (left) - Second Floor	SK	N/A		10/30/2020	-	-	-	Sign Required	-	-	-
1008	Ladies Room (right) - Second Floor	SK	N/A		10/30/2020	-	-	-	Sign Required	-	-	-
1009	Men's Room (left) - Second Floor	SK	N/A		10/30/2020	-	-	-	Sign Required	-	-	-
1009	Men's Room (right) - Second Floor	SK	N/A		10/30/2020	-	-	-	Sign Required	-	-	-
1010-1	Staff Restroom - Third Floor	SK	App		10/30/2020	-	-	-	Sign Required	-	-	-
1011-1	Lunch Area	SK	App	2.78	10/30/2020	-	-	-	None	-	-	-
1011-2	Lunch Area	SPY	App	3.1	10/30/2020	-	-	-	None	-	-	-

Action Level = 15.0 parts per billion (ppb) (µg/L)



**Laboratory Report**

NYE Report #: 2204366-16052

November 2, 2020

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: Rye Brook Administration Building

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on October 30, 2020. New York Environmental analyzed the samples on October 31, 2020 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	30 Oct 2020
Date Received:	30 Oct 2020
Date Analyzed:	31 Oct 2020

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
201030P078	1	Kitchen Sink-SK, Initial	1.00	1.32	µg/L	
201030P079	2	Lunch Area Sink-SK, Initial	1.00	2.78	µg/L	
201030P080	3	Lunch Area Sprayer-SPY, Initial	1.00	3.10	µg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

## Appendix C

Southern Westchester BOCES  
Rye Lake Campus

School Water Outlet Inventory

Lead in School Drinking Water Program 2020

Space #	Sample Location	Fixture Type	App or N/A	Latest 1 <sup>st</sup> Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remedial Recommendation	Remedial Response	Post Remedial Results (ppb)	Post Remedial Sampling Date
1001-1	Building 2 Kitchen 3-Bay	SK	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1001-2	Building 2 Kitchen 3-Bay	SPY	App	5.22	10/29/2020	-	-	-	None	-	-	-
1001-3	Building 2 Kitchen Steamer Oven	OS	N/A		10/30/2020	-	-	-	None	No Lead Fixture	-	-
1001-4	Building 2 Kitchen Ice Machine	IM	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1001-5	Building 2 Kitchen Handwash	SK	N/A		10/29/2020	-	-	-	Sign Required	-	-	-
1001-6	Building 2 Kitchen 2-Bay	SK	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1002-1	Building 2 Nurse's Office Bathroom (left)	SK	App	10.2	10/29/2020	-	-	-	None	-	-	-
1002-2	Building 2 Nurse's Office Bathroom (right)	SK	App	8.07	10/29/2020	-	-	-	None	-	-	-
1003-1	Building 2 Room 133 Girl's Bathroom (left)	SK	App	2.63	10/29/2020	-	-	-	None	-	-	-
1003-2	Building 2 Room 133 Girl's Bathroom (right)	SK	App	7	10/29/2020	-	-	-	None	-	-	-
1004-1	Building 2 Room 138	SK	App	15.8	10/29/2020				Additional Sampling Required			
1005-1	Building 2 Hall by Room 140	WF	App		10/29/2020	-	-	-	None	Removed from Service	-	-
1005-2	Building 2 Hall by Room 140	BF	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1006-1	Building 2 Room 140	SK	App	35.7	10/29/2020				Additional Sampling Required			
1007-1	Building 2 Room 141	SK	App	5.59	10/29/2020	-	-	-	None	-	-	-
1007-2	Building 2 Room 141	SPY	App	254	10/29/2020				Additional Sampling Required			
1008-1	Building 2 Main Office Bathroom	SK	App	8.87	10/29/2020	-	-	-	None	-	-	-
1009-1	Building 2 Main Lobby	WF	App		10/29/2020	-	-	-	None	Removed from Service	-	-
1009-2	Building 2 Main Lobby	BF	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1010-1	Building 2 Main Lobby Staff Bathroom	SK	N/A		10/29/2020	-	-	-	None	Locked Door	-	-

Action Level = 15.0 parts per billion (ppb) (µg/L)

Space #	Sample Location	Fixture Type	App or N/A	Latest 1 <sup>st</sup> Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remedial Recommendation	Remedial Response	Post Remedial Results (ppb)	Post Remedial Sampling Date
1011-1	Building 2 Main Lobby Men's Bathroom	SK	App	1.47	10/29/2020	-	-	-	None	-	-	-
1012-1	<b>Building 2 Main Lobby Women's Bathroom</b>	<b>SK</b>	<b>App</b>	<b>60.1</b>	<b>10/29/2020</b>				<b>Additional Sampling Required</b>			
1013-1	Building 2 Custodial Closet by Room 113	SS	N/A		10/29/2020	-	-	-	None	Locked Door	-	-
1014-1	Building 2 Room 113	SK	App	2.27	10/29/2020	-	-	-	None	-	-	-
1015-1	Building 2 Hall by Room 113	WF	App		10/29/2020	-	-	-	None	Removed from Service	-	-
1015-2	Building 2 Hall by Room 113	BF	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1016-1	Building 2 Room 116	SK	App	9.54	10/29/2020	-	-	-	None	-	-	-
1016-2	<b>Building 2 Room 116</b>	<b>SPY</b>	<b>App</b>	<b>137</b>	<b>10/29/2020</b>				<b>Additional Sampling Required</b>			
1017-1	Building 2 Room 117	SK	App		10/29/2020	-	-	-	None	Removed from Service	-	-
1018-1	<b>Building 2 Room 118</b>	<b>SK</b>	<b>App</b>	<b>117</b>	<b>10/29/2020</b>				<b>Additional Sampling Required</b>			
1019-1	Building 2 Second Floor Hall	WF	App		10/29/2020	-	-	-	None	Removed from Service	-	-
1019-2	Building 2 Second Floor Hall	BF	App	1.68	10/29/2020	-	-	-	None	-	-	-
1020-1	Building 2 Second Floor Women's Bathroom (left)	SK	App	4.69	10/29/2020	-	-	-	None	-	-	-
1020-2	<b>Building 2 Second Floor Women's Bathroom (right)</b>	<b>SK</b>	<b>App</b>	<b>23.3</b>	<b>10/29/2020</b>				<b>Additional Sampling Required</b>			
1021-1	Building 2 Second Floor Men's Bathroom (left)	SK	App	2.83	10/29/2020	-	-	-	None	-	-	-
1021-2	Building 2 Second Floor Men's Bathroom (right)	SK	App	2.96	10/29/2020	-	-	-	None	-	-	-
1022-1	Building 2 Second Floor Custodial Closet	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1023-1	Building 2 Staff Lounge	SK	App	1.96	10/29/2020	-	-	-	None	-	-	-
1023-2	Building 2 Staff Lounge	SPY	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1024-1	<b>Building 2 Conference Room Kitchenette</b>	<b>SK</b>	<b>App</b>	<b>227</b>	<b>10/30/2020</b>				<b>Additional Sampling Required</b>			

Space #	Sample Location	Fixture Type	App or N/A	Latest 1 <sup>st</sup> Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remedial Recommendation	Remedial Response	Post Remedial Results (ppb)	Post Remedial Sampling Date
1024-2	Building 2 Conference Room Kitchenette	SPY	App	252	10/30/2020				Additional Sampling Required			
1025-1	Building 2 Second Floor Staff Unisex Bathroom	SK	N/A		10/29/2020	-	-	-	None	Locked Door	-	-
1026-1	Building 2 Second Floor Men's Bathroom	SK	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1027-1	Building 2 Second Floor Women's Bathroom	SK	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1028-1	Administration hall	WF	N/A		10/29/2020	-	-	-	None	Removed from Service	-	-
1028-2	Administration hall	BF	App	4.14	10/29/2020	-	-	-	None	-	-	-
2001-1	Building 1 Principal's Office Kitchenette	SK	App	18.4	10/29/2020				Additional Sampling Required			
2001-2	Building 1 Principal's Office Kitchenette	SPY	App	3.42	10/29/2020	-	-	-	None	-	-	-
2002-1	Building 1 Staff Bathroom	SK	N/A		10/29/2020	-	-	-	None	SIGN	-	-
2003-1	Building 1 Nurse's Office	SK	App	7.92	10/29/2020	-	-	-	None	-	-	-
2003-2	Building 1 Nurse's Office Bathroom	SK	App	6.8	10/29/2020	-	-	-	None	-	-	-
2004-1	Building 1 Staff Lounge	SK	App	2.52	10/29/2020	-	-	-	None	-	-	-
2004-2	Building 1 Staff Lounge	SK	App	1.04	10/29/2020	-	-	-	None	-	-	-
2004-3	Building 1 Staff Lounge Bathroom	SK	N/A		10/29/2020	-	-	-	None	Locked Door	-	-
2005-1	Building 1 Room 8 Life Skills	SK	App	4.14	10/29/2020	-	-	-	None	-	-	-
2005-2	Building 1 Room 8 Life Skills (lower sink)	SK	App	20.3	10/29/2020				Additional Sampling Required			
2005-3	Building 1 Room 8 Life Skills Bathroom	SK	App	6.39	10/29/2020	-	-	-	None	-	-	-
2006-1	Building 1 Room 10	SK	App	8.73	10/29/2020	-	-	-	None	-	-	-
2006-2	Building 1 Room 10 Bathroom	SK	App	2.66	10/29/2020	-	-	-	None	-	-	-
2007-1	Building 1 Room 15	SK	App	23.4	10/29/2020				Additional Sampling Required			

Southern Westchester BOCES  
Rye Lake Campus

School Water Outlet Inventory

Lead in School Drinking Water Program 2020

Space #	Sample Location	Fixture Type	App or N/A	Latest 1 <sup>st</sup> Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remedial Recommendation	Remedial Response	Post Remedial Results (ppb)	Post Remedial Sampling Date
2007-2	Building 1 Room 15 Bathroom	SK	App	13.7	10/29/2020	-	-	-	None	-	-	-
2008-1	Building 1 Room 17	SK	App	4.15	10/29/2020	-	-	-	None	-	-	-
2008-2	Building 1 Room 17 Bathroom	SK	App	1.28	10/29/2020	-	-	-	None	-	-	-
2009-1	Building 1 Room 19	SK	App	31.3	10/29/2020				Additional Sampling Required			
2009-2	Building 1 Room 19 Bathroom	SK	App	4.52	10/29/2020	-	-	-	None	-	-	-
2010-1	Building 1 Room 21	SK	App	27.3	10/29/2020				Additional Sampling Required			
2010-2	Building 1 Room 21 Bathroom	SK	App	2.97	10/29/2020	-	-	-	None	-	-	-
3001-1	Building H	SK	App	2.86	10/29/2020	-	-	-	None	-	-	-
3001-2	Building H	SPY	App	<1.0	10/29/2020	-	-	-	None	-	-	-
3001-3	Building H Student Bathroom	SK	App	11.8	10/29/2020	-	-	-	None	-	-	-
3001-4	Building H Adult Bathroom	SK	App	3.5	10/29/2020	-	-	-	None	-	-	-
3002-1	Building G Bathroom	SK	App	<1.0	10/29/2020	-	-	-	None	-	-	-
3003-1	Building F Staff Lounge	SK	App	4.28	10/29/2020	-	-	-	None	-	-	-
3003-2	Building F Staff Bathroom	SK	App	36.7	10/29/2020				Additional Sampling Required			
3003-3	Building F Unisex Bathroom	SK	App	6.2	10/29/2020	-	-	-	None	-	-	-
3004-1	Building E Bathroom	SK	App	2.37	10/29/2020	-	-	-	None	-	-	-
3005-1	Building D Bathroom	SK	App	2.2	10/29/2020	-	-	-	None	-	-	-
3006-1	Building B Bathroom	SK	App	23.9	10/29/2020				Additional Sampling Required			
3007-1	Building A	SK	App	11.8	10/29/2020	-	-	-	None	-	-	-
3007-2	Building A Bathroom	SK	App	7.5	10/29/2020	-	-	-	None	-	-	-

Action Level = 15.0 parts per billion (ppb) (µg/L)

**Southern Westchester BOCES  
Rye Lake Campus**

**School Water Outlet Inventory**

**Lead in School Drinking Water Program 2020**

Space #	Sample Location	Fixture Type	App or N/A	Latest 1 <sup>st</sup> Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remedial Recommendation	Remedial Response	Post Remedial Results (ppb)	Post Remedial Sampling Date
3008-1	Building 7 Men's Bathroom	SK	N/A		10/29/2020	-	-	-	None	Staff Only Building	-	-
3008-2	Building 7 Women's Bathroom	SK	N/A		10/29/2020	-	-	-	None	Staff Only Building	-	-
3009-1	Maintenance Shop Kitchenette	SK	App	5.49	10/30/2020	-	-	-	None	-	-	-
3009-2	Maintenance Shop Bathroom	SK	N/A		10/29/2020	-	-	-	None		-	-
3009-3	Maintenance Shop Garage	SS	N/A		10/29/2020	-	-	-	None		-	-

Action Level = 15.0 parts per billion (ppb) (µg/L)



**Laboratory Report**

NYE Report #: 2204364-16050

November 3, 2020

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: Rye Lake Campus

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on October 30, 2020. New York Environmental analyzed the samples on October 31, 2020 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	29 Oct 2020
Date Received:	30 Oct 2020
Date Analyzed:	31 Oct 2020

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
201030P001	1	Building 2 Kitchen 3-Bay-SK; Initial	1.00	<1.00	µg/L	
201030P002	2	Building 2 Kitchen 3-Bay-SPY; Initial	1.00	5.22	µg/L	
201030P003	3	Building 2 Kitchen Ice Machine-IM; Initial	1.00	<1.00	µg/L	
201030P004	4	Building 2 Kitchen 2-Bay -SK; Initial	1.00	<1.00	µg/L	
201030P005	5	Building 2 Nurse's Office Bathroom (left)-SK; Initial	1.00	10.2	µg/L	
201030P006	6	Building 2 Nurse's Office Bathroom (right)-SK; Initial	1.00	8.07	µg/L	
201030P007	7	Building 2 Room 133 Girl's Bathroom (left)-SK; Initial	1.00	2.63	µg/L	
201030P008	8	Building 2 Room 133 Girl's Bathroom (right)-SK; Initial	1.00	7.00	µg/L	
201030P009	9	Building 2 Room 138-SK; Initial	1.00	15.8	µg/L	H
201030P010	10	Building 2 Hall by Room 140-BF; Initial	1.00	<1.00	µg/L	
201030P011	11	Building 2 Room 140-SK; Initial	1.00	35.7	µg/L	H
201030P012	12	Building 2 Room 141-SK; Initial	1.00	5.59	µg/L	
201030P013	13	Building 2 Room 141-SPY; Initial	1.00	254	µg/L	E,H
201030P014	14	Building 2 Main Office Bathroom-SK; Initial	1.00	8.87	µg/L	
201030P015	15	Building 2 Main Lobby-BF; Initial	1.00	<1.00	µg/L	
201030P016	16	Building 2 Main Lobby Men's Bathroom-SK; Initial	1.00	1.47	µg/L	
201030P017	17	Building 2 Main Lobby Women's Bathroom-SK; Initial	1.00	60.1	µg/L	E,H
201030P018	18	Building 2 Room 113-SK; Initial	1.00	2.27	µg/L	
201030P019	19	Building 2 Hall by Room 113- BF; Initial	1.00	<1.00	µg/L	
201030P020	20	Building 2 Room 116-SK; Initial	1.00	9.54	µg/L	
201030P021	21	Building 2 Room 116-SPY; Initial	1.00	137	µg/L	E,H
201030P022	22	Building 2 Room 118-SK; Initial	1.00	117	µg/L	E,H
201030P023	23	Building 2 Second Floor Hall-BF; Initial	1.00	1.68	µg/L	
201030P024	24	Building 2 Second Floor Women's Bathroom (left)-SK; Initial	1.00	4.69	µg/L	
201030P025	25	Building 2 Second Floor Women's Bathroom (right)-SK; Initial	1.00	23.3	µg/L	H
201030P026	26	Building 2 Second Floor Men's Bathroom (left)-SK; Initial	1.00	2.83	µg/L	



Date Collected:	29 Oct 2020
Date Received:	30 Oct 2020
Date Analyzed:	31 Oct 2020

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
201030P027	27	Building 2 Second Floor Men's Bathroom (right)-SK; Initial	1.00	2.96	µg/L	
201030P028	28	Building 2 Staff Lounge-SK; Initial	1.00	1.96	µg/L	
201030P029	29	Building 2 Staff Lounge-SPY; Initial	1.00	<1.00	µg/L	
201030P030	30	Building 2 Conference Room Kitchenette-SK; Initial	1.00	227	µg/L	E,H
201030P031	31	Building 2 Conference Room Kitchenette-SPY; Initial	1.00	252	µg/L	E,H
201030P032	32	Administration hall-BF; Initial	1.00	4.14	µg/L	
201030P033	33	Building 1 Principal's Office Kitchenette-SK; Initial	1.00	18.4	µg/L	H
201030P034	34	Building 1 Principal's Office Kitchenette-SPY; Initial	1.00	3.42	µg/L	
201030P035	35	Building 1 Nurse's Office- SK; Initial	1.00	7.92	µg/L	
201030P036	36	Building 1 Nurse's Office Bathroom-SK; Initial	1.00	6.80	µg/L	
201030P037	37	Building 1 Staff Lounge-SK; Initial	1.00	2.52	µg/L	
201030P038	38	Building 1 Staff Lounge-SK; Initial	1.00	1.04	µg/L	
201030P039	39	Building 1 Room 8 Life Skills-SK; Initial	1.00	4.13	µg/L	
201030P040	40	Building 1 Room 8 Life Skills (lower sink)-SK; Initial	1.00	20.3	µg/L	H
201030P041	41	Building 1 Room 8 Life Skills Bathroom-SK; Initial	1.00	6.39	µg/L	
201030P042	42	Building 1 Room 10-SK; Initial	1.00	8.73	µg/L	
201030P043	43	Building 1 Room 10 Bathroom -SK; Initial	1.00	2.66	µg/L	
201030P044	44	Building 1 Room 15 -SK; Initial	1.00	23.4	µg/L	H
201030P045	45	Building 1 Room 15 Bathroom-SK; Initial	1.00	13.7	µg/L	
201030P046	46	Building 1 Room 17-SK; Initial	1.00	4.15	µg/L	
201030P047	47	Building 1 Room 17 Bathroom-SK; Initial	1.00	1.28	µg/L	
201030P048	48	Building 1 Room 19-SK; Initial	1.00	31.3	µg/L	H
201030P049	49	Building 1 Room 19 Bathroom-SK; Initial	1.00	4.52	µg/L	
201030P050	50	Building 1 Room 21-SK; Initial	1.00	27.3	µg/L	H
201030P051	51	Building 1 Room 21 Bathroom -SK; Initial	1.00	2.97	µg/L	
201030P052	52	Building H-SK; Initial	1.00	2.86	µg/L	
201030P053	53	Building H-SPY; Initial	1.00	<1.00	µg/L	



Date Collected:	29 Oct 2020
Date Received:	30 Oct 2020
Date Analyzed:	31 Oct 2020

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
201030P054	54	Building H Student Bathroom-SK; Initial	1.00	11.8	µg/L	
201030P055	55	Building H Adult Bathroom-SK; Initial	1.00	3.50	µg/L	
201030P056	56	Building G Bathroom-SK; Initial	1.00	<1.00	µg/L	
201030P057	57	Building F Staff Lounge-SK; Initial	1.00	4.28	µg/L	
201030P058	58	Building F Staff Bathroom-SK; Initial	1.00	36.7	µg/L	H
201030P059	59	Building F Unisex Bathroom-SK; Initial	1.00	6.20	µg/L	
201030P060	60	Building E Bathroom-SK; Initial	1.00	2.37	µg/L	
201030P061	61	Building D Bathroom-SK; Initial	1.00	2.20	µg/L	
201030P062	62	Building B Bathroom-SK; Initial	1.00	23.9	µg/L	H
201030P063	63	Building A -SK; Initial	1.00	11.8	µg/L	
201030P064	64	Building A Bathroom -SK; Initial	1.00	7.50	µg/L	
201030P065	65	Maintenance Shop Kitchenette-SK; Initial	1.00	5.49	µg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

E: Sample result exceeds instrument calibration, value is estimated.

H: Sample result exceeds applicable regulatory limit.



## Appendix D

**Southern Westchester BOCES  
St. Matthew's School**

**School Water Outlet Inventory**

**Lead in School Drinking Water Program 2020**

Space #	Sample Location	Fixture Type	App or N/A	Latest 1 <sup>st</sup> Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remedial Recommendation	Remedial Response	Post Remedial Results (ppb)	Post Remedial Sampling Date
1000-1	Women's Room - First Floor	SK	App	<1.0	10/30/2020	-	-	-	None	-	-	-
1001-1	Room 104 Pantry	SK	App	1.13	10/30/2020	-	-	-	None	-	-	-
1002-1	Men's Room - First Floor	SK	App	<1.0	10/30/2020	-	-	-	None	-	-	-
1003	Pastor's Office Bathroom	SK	App		10/30/2020	-	-	-	None	Locked Door	-	-
1004-1	Men's Room - Second Floor	SK	App	3.49	10/30/2020	-	-	-	None	-	-	-
1005-1	Women's Room (left) - Second Floor	SK	App	2.64	10/30/2020	-	-	-	None	-	-	-
1005-2	Women's Room (right) - Second Floor	SK	App	3	10/30/2020	-	-	-	None	-	-	-
1006-1	Room 203	SK	App	5.75	10/30/2020	-	-	-	None	-	-	-
1007-1	Room 202 Pantry	SK	App	11.5	10/30/2020	-	-	-	None	-	-	-
1008	Parlor Room Bathroom(s)	SK	App		10/30/2020	-	-	-	None	Locked Door(s)	-	-

Action Level = 15.0 parts per billion (ppb) (µg/L)

**Laboratory Report**

NYE Report #: 2204368-16053

November 2, 2020

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: St. Matthews

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on October 30, 2020. New York Environmental analyzed the samples on October 31, 2020 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	30 Oct 2020
Date Received:	30 Oct 2020
Date Analyzed:	31 Oct 2020

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
201030P081	1	Women's Room sink-SK, Initial	1.00	<1.00	µg/L	
201030P082	2	Room 104 Pantry Sink-SK, Initial	1.00	1.13	µg/L	
201030P083	3	Men's Room Sink-SK, Initial	1.00	<1.00	µg/L	
201030P084	4	Men's Room Sink-SK, Initial	1.00	3.49	µg/L	
201030P085	5	Women's Room Sink-Left-SK, Initial	1.00	2.64	µg/L	
201030P086	6	Women's Room Sink-Right-SK, Initial	1.00	3.00	µg/L	
201030P087	7	Room 203 Sink-SK, Initial	1.00	5.75	µg/L	
201030P088	8	Room 202 Pantry-Sink-SK, Initial	1.00	11.5	µg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation



## Appendix E

Southern Westchester BOCES  
Valhalla CTE Campus

School Water Outlet Inventory

Lead in School Drinking Water Program 2020

Space #	Sample Location	Fixture Type	App or N/A	Latest 1 <sup>st</sup> Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remedial Recommendation	Remedial Response	Post Remedial Results (ppb)	Post Remedial Sampling Date
1001-1	Room A103	WF	App		10/29/2020	-	-	-	None	Removed From Service	-	-
1001-2	Room A103	BF	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1001-3	Room A103 Bathroom @A	SK	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1001-4	Room A103 Bathroom @ B	SK	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1002-1	Room A102 Bathroom	SK	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1002-2	Room A102	WF	App		10/29/2020	-	-	-	None	Removed From Service	-	-
1002-3	Room A102	BF	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1002-4	Room A102	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1003-1	Room A101B Bathroom @A	SK	App	4.6	10/29/2020	-	-	-	None	-	-	-
1003-2	Room A101B Bathroom @B	SK	App	7.13	10/29/2020	-	-	-	None	-	-	-
1004-1	Room A101 Bathroom @A	SK	App	1.39	10/29/2020	-	-	-	None	-	-	-
1004-2	Room A101 Bathroom Trough	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
						-	-	-	None	-	-	-
1001-1	Boiler Room Handwash	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1002-1	Bathroom by Boiler Room	SK	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1003-1	B-111	SK	App	1.79	10/29/2020	-	-	-	None	-	-	-
1003-2	B-111	SPY	App	1.33	10/29/2020	-	-	-	None	-	-	-
1004-1	Hall by B-110	WF	App		10/29/2020	-	-	-	None	Removed From Service	-	-
1004-2	Hall by B-110 Bottle Filler	BF	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1005-1	B-108 Kitchenette	SK	App	215	10/29/2020				Additional Sampling Required			

Action Level = 15.0 parts per billion (ppb) (µg/L)

Southern Westchester BOCES  
Valhalla CTE Campus

School Water Outlet Inventory

Lead in School Drinking Water Program 2020

Space #	Sample Location	Fixture Type	App or N/A	Latest 1 <sup>st</sup> Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remedial Recommendation	Remedial Response	Post Remedial Results (ppb)	Post Remedial Sampling Date
1006-1	Girls Bathroom by B-108 @ A	SK	App	52.7	10/29/2020				Additional Sampling Required			
1006-2	Girls Bathroom by B-108 @ B	SK	App	4.98	10/29/2020	-	-	-	None	-	-	-
1006-3	Girls Bathroom by B-108 @ C	SK	App	5.31	10/29/2020	-	-	-	None	-	-	-
1006-4	Girls Bathroom by B-108 @ D	SK	App	7.15	10/29/2020	-	-	-	None	-	-	-
1007-1	Custodial Closet by B-108	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1008-1	Staff Bathroom by B-106	SK	App	1.62	10/29/2020	-	-	-	None	-	-	-
1009-1	Nurses Office	SK	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1009-2	Nurses Office Bathroom	SK	App	2.11	10/29/2020	-	-	-	None	-	-	-
1010-1	Boys Bathroom by B-104 @ A	SK	App	2.62	10/29/2020	-	-	-	None	-	-	-
1010-2	Boys Bathroom by B-104 @ B	SK	App	3.14	10/29/2020	-	-	-	None	-	-	-
1011-1	B-102	SK	App	29.7	10/29/2020				Additional Sampling Required			
1012-1	Hall by B-101	WF	App		10/29/2020	-	-	-	None	Removed From Service	-	-
1012-2	Hall by B-101 Bottle Filler	BF	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1013-1	B-101 Storage Room	SK	App	62.4	10/29/2020				Additional Sampling Required			
						-	-	-	None	-	-	-
1001-1	C-101 Cosmetology Lab	SK	App	4.21	10/29/2020	-	-	-	None	-	-	-
1001-2	C-101 Cosmetology Lab Hairwash Station @ A	SPY	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1001-3	C-101 Cosmetology Lab Hairwash Station @ B	SPY	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1001-4	C-101 Cosmetology Lab Hairwash Station @ C	SPY	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1001-5	C-101 Cosmetology Lab Hairwash Station @ D	SPY	N/A		10/29/2020	-	-	-	None	SIGN	-	-

Action Level = 15.0 parts per billion (ppb) (µg/L)

**Southern Westchester BOCES  
Valhalla CTE Campus**

**School Water Outlet Inventory**

**Lead in School Drinking Water Program 2020**

Space #	Sample Location	Fixture Type	App or N/A	Latest 1 <sup>st</sup> Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remedial Recommendation	Remedial Response	Post Remedial Results (ppb)	Post Remedial Sampling Date
1001-6	C-101 Cosmetology Lab Hairwash Station @ E	SPY	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1001-7	C-101 Cosmetology Lab Hairwash Station @ F	SPY	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1002-1	Staff Bathroom by C-101	SK	App	3.43	10/29/2020	-	-	-	None	-	-	-
1003-1	C-102 Cosmetology Lab	SK	App	12.9	10/29/2020	-	-	-	None	-	-	-
1003-2	C-102 Cosmetology Lab Hairwash Station @ A	SPY	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1003-3	C-102 Cosmetology Lab Hairwash Station @ B	SPY	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1003-4	C-102 Cosmetology Lab Hairwash Station @ C	SPY	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1003-5	C-102 Cosmetology Lab Hairwash Station @ D	SPY	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1003-6	C-102 Cosmetology Lab Hairwash Station @ E	SPY	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1003-7	C-102 Cosmetology Lab Hairwash Station @ F	SPY	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1004-1	C-103 Vet Service Dog Washing Station	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1004-2	C-103 Vet Service Dog Washing Station	SPY	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1005-1	C-104 Vet Service Dog Washing Station	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1005-2	C-104 Vet Service Dog Washing Station	SPY	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1006-1	Custodial Closet by Courtyard	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1007-1	Hall by Courtyard	WF	App		10/29/2020	-	-	-	None	Removed From Service	-	-
1007-2	Hall by Courtyard	BF	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1008-1	Girls Bathroom by Courtyard @ A	SK	App	3.43	10/29/2020	-	-	-	None	-	-	-
1008-2	Girls Bathroom by Courtyard @ B	SK	App	2.31	10/29/2020	-	-	-	None	-	-	-
1008-3	Girls Bathroom by Courtyard @ C	SK	App	3.1	10/29/2020	-	-	-	None	-	-	-

Action Level = 15.0 parts per billion (ppb) (µg/L)

**Southern Westchester BOCES  
Valhalla CTE Campus**

**School Water Outlet Inventory**

**Lead in School Drinking Water Program 2020**

Space #	Sample Location	Fixture Type	App or N/A	Latest 1 <sup>st</sup> Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remedial Recommendation	Remedial Response	Post Remedial Results (ppb)	Post Remedial Sampling Date
1008-4	Girls Bathroom by Courtyard @ D	SK	App	12.2	10/29/2020	-	-	-	None	-	-	-
2001-1	Custodial Closet by C-204	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
2002-1	Hall by C-204	WF	App		10/29/2020	-	-	-	None	Removed From Service	-	-
2002-2	Hall by C-204	BF	App	<1.0	10/29/2020	-	-	-	None	-	-	-
2003-1	C-204 EMS	SK	App	5.83	10/29/2020	-	-	-	None	-	-	-
2004-1	C-202	SK	App	3.3	10/29/2020	-	-	-	None	-	-	-
2005-1	Staff Lounge Kitchenette	SK	App	1.78	10/29/2020	-	-	-	None	-	-	-
2006-1	Womens Bathroom by C-201	SK	App	1.73	10/29/2020	-	-	-	None	-	-	-
2007-1	Mens Bathroom by C-201	SK	App	1.94	10/29/2020	-	-	-	None	-	-	-
2008-1	C-201 Cosmetology Lab	SK	App	4.94	10/29/2020	-	-	-	None	-	-	-
2008-2	C-201 Cosmetology Lab Hairwash Station @ A	SPY	N/A		10/29/2020	-	-	-	None	SIGN	-	-
2008-3	C-201 Cosmetology Lab Hairwash Station @ B	SPY	N/A		10/29/2020	-	-	-	None	SIGN	-	-
2008-4	C-201 Cosmetology Lab Hairwash Station @ C	SPY	N/A		10/29/2020	-	-	-	None	SIGN	-	-
2008-5	C-201 Cosmetology Lab Hairwash Station @ D	SPY	N/A		10/29/2020	-	-	-	None	SIGN	-	-
2008-6	C-201 Cosmetology Lab Hairwash Station @ E	SPY	N/A		10/29/2020	-	-	-	None	SIGN	-	-
2009-1	C-203 Cosmetology Lab	SK	App	2.83	10/29/2020	-	-	-	None	-	-	-
2009-2	C-203 Cosmetology Lab Hairwash Station @ A	SPY	N/A		10/29/2020	-	-	-	None	SIGN	-	-
2009-3	C-203 Cosmetology Lab Hairwash Station @ B	SPY	N/A		10/29/2020	-	-	-	None	SIGN	-	-
2009-4	C-203 Cosmetology Lab Hairwash Station @ C	SPY	N/A		10/29/2020	-	-	-	None	SIGN	-	-
2010-1	Girls Bathroom by C-203 @ A	SK	App	2.53	10/29/2020	-	-	-	None	-	-	-

Action Level = 15.0 parts per billion (ppb) (µg/L)

Space #	Sample Location	Fixture Type	App or N/A	Latest 1 <sup>st</sup> Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remedial Recommendation	Remedial Response	Post Remedial Results (ppb)	Post Remedial Sampling Date
2010-2	Girls Bathroom by C-203 @ B	SK	App	2.33	10/29/2020	-	-	-	None	-	-	-
2010-3	Girls Bathroom by C-203 @ C	SK	App	6	10/29/2020	-	-	-	None	-	-	-
2010-4	Girls Bathroom by C-203 @ D	SK	App	5.64	10/29/2020	-	-	-	None	-	-	-
						-	-	-	None	-	-	-
1001-1	Mens Bathroom by Lobby @ A	SK	App	2.54	10/29/2020	-	-	-	None	-	-	-
1001-2	Mens Bathroom by Lobby @ B	SK	App	4.26	10/29/2020	-	-	-	None	-	-	-
1002-1	Womens Bathroom by Lobby @ A	SK	App	1.83	10/29/2020	-	-	-	None	-	-	-
1002-2	Womens Bathroom by Lobby @ B	SK	App	5.47	10/29/2020	-	-	-	None	-	-	-
1003-1	Utility Closet by Lobby @ A	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1003-2	Utility Closet by Lobby @ B	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1004-1	Hall by Lobby	WF	App		10/29/2020	-	-	-	None	Removed From Service	-	-
1004-2	Hall by Lobby Bottle Filler	BF	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1005-1	Mezzanine Kitchenette	SK	App	16	10/29/2020				Additional Sampling Required			
1006-1	D-202 Main Office Womens Bathroom	SK	App	1.45	10/29/2020	-	-	-	None	-	-	-
1007-1	D-202 Main Office Mens Bathroom	SK	App	2.52	10/29/2020	-	-	-	None	-	-	-
1008-1	D-204 Assistant Principal Kitchenette	SK	App	5.1	10/29/2020	-	-	-	None	-	-	-
2001-1	D-302 Study Hall	SK	App	<1.0	10/29/2020	-	-	-	None	-	-	-
2002-1	Girls Bathroom by D-302	SK	App	<1.0	10/29/2020	-	-	-	None	-	-	-
2003-1	Hall by D-302	WF	App		10/29/2020	-	-	-	None	Removed From Service	-	-
2003-2	Hall by D-302 Bottle Filler	BF	App	<1.0	10/29/2020	-	-	-	None	-	-	-

Southern Westchester BOCES  
Valhalla CTE Campus

School Water Outlet Inventory

Lead in School Drinking Water Program 2020

Space #	Sample Location	Fixture Type	App or N/A	Latest 1 <sup>st</sup> Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remedial Recommendation	Remedial Response	Post Remedial Results (ppb)	Post Remedial Sampling Date
2004-1	Custodial Closet by D-302	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
2005-1	D-303	SK	App	1.43	10/29/2020	-	-	-	None	-	-	-
2005-2	D-303	SPY	App	2.3	10/29/2020	-	-	-	None	-	-	-
<b>2006-1</b>	<b>D-304</b>	<b>SK</b>	<b>App</b>	<b>47</b>	<b>10/29/2020</b>				<b>Additional Sampling Required</b>			
2007-1	D-308	SK	App	1.84	10/29/2020	-	-	-	None	-	-	-
2007-2	D-308	SPY	App	<1.0	10/29/2020	-	-	-	None	-	-	-
0001-1	Custodial Closet by Café	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
0002-1	Boys Bathroom by Café @ A	SK	App	2.51	10/29/2020	-	-	-	None	-	-	-
0002-2	Boys Bathroom by Café @ B	SK	App	4.29	10/29/2020	-	-	-	None	-	-	-
0003-1	Girls Bathroom by Café @ A	SK	App	1.53	10/29/2020	-	-	-	None	-	-	-
0003-2	Girls Bathroom by Café @ B	SK	App	4.06	10/29/2020	-	-	-	None	-	-	-
0004-1	Hall by Café	WF	App		10/29/2020	-	-	-	None	Removed From Service	-	-
0005-1	D-101 Life Skills Room	SK	App	3.36	10/29/2020	-	-	-	None	-	-	-
0005-2	D-101 Life Skills Room	SPY	App	<1.0	10/29/2020	-	-	-	None	-	-	-
0005-3	D-101 Life Skills Room	SS	App	5.41	10/29/2020	-	-	-	None	-	-	-
0005-4	D-101 Life Skills Room Bathroom	SK	App	2.82	10/29/2020	-	-	-	None	-	-	-
0006-1	D-103 Café Kitchen 2 Bay	SK	App	1.04	10/29/2020	-	-	-	None	-	-	-
0006-2	D-103 Café Kitchen 3 Bay	SPY	App	<1.0	10/29/2020	-	-	-	None	-	-	-
0006-3	D-103 Café Kitchen 3 Bay	SK	App	2.25	10/29/2020	-	-	-	None	-	-	-
0006-4	D-103 Café Kitchen Handwash	SK	N/A		10/29/2020	-	-	-	None	SIGN	-	-

Action Level = 15.0 parts per billion (ppb) (µg/L)

Southern Westchester BOCES  
Valhalla CTE Campus

School Water Outlet Inventory

Lead in School Drinking Water Program 2020

Space #	Sample Location	Fixture Type	App or N/A	Latest 1 <sup>st</sup> Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remedial Recommendation	Remedial Response	Post Remedial Results (ppb)	Post Remedial Sampling Date
0006-5	D-103 Café Kitchen	IM	App	<1.0	10/29/2020	-	-	-	None	-	-	-
0007-1	Boiler Room	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
						-	-	-	None	-	-	-
1001-1	Room E202 Bathroom @A	SK	App	5.5	10/29/2020	-	-	-	None	-	-	-
1001-2	Room E202 Bathroom @B	SK	App	9.57	10/29/2020	-	-	-	None	-	-	-
1001-3	Room E202	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1002-1	Room E201	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1002-2	Room E201 Bathroom @A	SK	App	6.21	10/29/2020	-	-	-	None	-	-	-
1002-3	Room E201 Bathroom @B	SK	App	11.3	10/29/2020	-	-	-	None	-	-	-
1003-1	Room E102 Bathroom	SK	App	6.29	10/29/2020	-	-	-	None	-	-	-
1003-2	Room E102 Bathroom @A	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1003-3	Room E102 Bathroom @B	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1004-1	Hallway between Room E101 & E102	WF	App		10/29/2020	-	-	-	None	Removed From Service	-	-
1004-2	Hallway between Room E101 & E102	BF	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1005-1	Boys Bathroom @A between Room E101 & E102	SK	App	3.73	10/29/2020	-	-	-	None	-	-	-
1005-2	Boys Bathroom @B between Room E101 & E102	SK	App	56.2	10/29/2020				Additional Sampling Required			
1006-1	Room E101 @A	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1006-2	Room E101 @B	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1007-1	Custodial Closet in Room E101	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
						-	-	-	None	-	-	-

Action Level = 15.0 parts per billion (ppb) (µg/L)



**Southern Westchester BOCES  
Valhalla CTE Campus**

**School Water Outlet Inventory**

**Lead in School Drinking Water Program 2020**

Space #	Sample Location	Fixture Type	App or N/A	Latest 1 <sup>st</sup> Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remedial Recommendation	Remedial Response	Post Remedial Results (ppb)	Post Remedial Sampling Date
1001-1	I-101 Culinary Arts II Dishwash Station	SK	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1001-2	I-101 Culinary Arts II 2 Bay	SK	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1001-3	I-101 Culinary Arts II Handwash	SK	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1001-4	I-101 Culinary Arts II 3 Bay	SK	App	2.84	10/29/2020	-	-	-	None	-	-	-
1002-1	Womens Bathroom by I-101	SK	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1003-1	Mens Bathroom by I-101	SK	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1004-1	Custodial Closet by I-101	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1005-1	I-102 Culinary Arts I Handwash @ A	SK	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1005-2	I-102 Culinary Arts I Island	SK	App	3.77	10/29/2020	-	-	-	None	-	-	-
1005-3	I-102 Culinary Arts I Pot Filler	SP	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1005-4	I-102 Culinary Arts I Handwash @ B	SK	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1005-5	I-102 Culinary Arts I Dishwash Station	SPY	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1005-6	I-102 Culinary Arts I 3 Bay @ A	SK	App	1.54	10/29/2020	-	-	-	None	-	-	-
1005-7	I-102 Culinary Arts I 3 Bay @ B	SK	App	2.05	10/29/2020	-	-	-	None	-	-	-
1005-8	I-102 Culinary Arts I 2 Bay	SK	App	1.33	10/29/2020	-	-	-	None	-	-	-
1005-9	I-102 Culinary Arts I	IM	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1006-1	I-104 Auto Trades Bathroom	SK	App	1.92	10/29/2020	-	-	-	None	-	-	-
1006-2	I-104 Auto Trades	SS	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1007-1	I-105 Auto Trades Bathroom	SK	App	3.36	10/29/2020	-	-	-	None	-	-	-
1007-2	I-105 Auto Trades Trough @ A	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-

Action Level = 15.0 parts per billion (ppb) (µg/L)

**Southern Westchester BOCES  
Valhalla CTE Campus**

**School Water Outlet Inventory**

**Lead in School Drinking Water Program 2020**

Space #	Sample Location	Fixture Type	App or N/A	Latest 1 <sup>st</sup> Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remedial Recommendation	Remedial Response	Post Remedial Results (ppb)	Post Remedial Sampling Date
1007-3	I-105 Auto Trades Trough @ B	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1007-4	I-105 Auto Trades Trough @ C	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1008-1	Womens Bathroom by I-109	SK	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1009-1	Mens Bathroom by I-109	SK	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1010-1	Hall by I-109	WF	App		10/29/2020	-	-	-	None	Removed From Service	-	-
1010-2	Hall by I-109 Bottle Filler	BF	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1011-1	I-110 Auto Service Bathroom	SK	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1011-2	I-110 Auto Service Handwash	SK	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1011-3	I-110 Auto Service	SS	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1011-4	I-110 Auto Service Trough @ A	SK	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1011-5	I-110 Auto Service Trough @ B	SK	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1011-6	I-110 Auto Service Trough @ C	SK	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1011-7	I-110 Auto Service Trough @ D	SK	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1011-8	I-110 Auto Service	WF	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1012-1	I-111 Auto Service Bathroom	SK	App	<1.0	10/29/2020	-	-	-	None	-	-	-
1012-2	I-111 Auto Service	SS	App	2.51	10/29/2020	-	-	-	None	-	-	-
1012-3	I-111 Auto Service Trough @ A	SK	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1012-4	I-111 Auto Service Trough @ B	SK	N/A		10/29/2020	-	-	-	None	SIGN	-	-
1012-5	I-111 Auto Service Trough @ C	SK	N/A		10/29/2020	-	-	-	None	SIGN	-	-

Action Level = 15.0 parts per billion (ppb) (µg/L)

**Laboratory Report**

NYE Report #: 2204338-16024

November 2, 2020

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: Valhalla CTE Campus- Building A

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on October 29, 2020. New York Environmental analyzed the samples on October 30, 2020 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	29 Oct 2020
Date Received:	29 Oct 2020
Date Analyzed:	30 Oct 2020

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
201029Q053	1	Room A103 -BF; Initial	1.00	<1.00	µg/L	
201029Q054	2	Room A103 Bathroom @A-SK; Initial	1.00	<1.00	µg/L	
201029Q055	3	Room A103 Bathroom @ B-SK; Initial	1.00	<1.00	µg/L	
201029Q056	4	Room A102 Bathroom-SK; Initial	1.00	<1.00	µg/L	
201029Q057	5	Room A102-BF; Initial	1.00	<1.00	µg/L	
201029Q058	6	Room A101B Bathroom @A-SK; Initial	1.00	4.60	µg/L	
201029Q059	7	Room A101B Bathroom @B-SK; Initial	1.00	7.13	µg/L	
201029Q060	8	Room A101 Bathroom @A-SK; Initial	1.00	1.39	µg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

**Laboratory Report**

NYE Report #: 2204346-16032

November 2, 2020

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: Valhalla CTE Campus- Building B

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on October 30, 2020. New York Environmental analyzed the samples on October 31, 2020 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	29 Oct 2020
Date Received:	30 Oct 2020
Date Analyzed:	31 Oct 2020

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
201030M001	1	Bathroom by Boiler Room-SK; Initial	1.00	<1.00	µg/L	
201030M002	2	B-111-SK; Initial	1.00	1.79	µg/L	
201030M003	3	B-111-SPY; Initial	1.00	1.33	µg/L	
201030M004	4	Hall by B-110 Bottle Filler-BF; Initial	1.00	<1.00	µg/L	
201030M005	5	B-108 Kitchenette-SK; Initial	1.00	215	µg/L	E,H
201030M006	6	Girls Bathroom by B-108 @ A-SK; Initial	1.00	52.7	µg/L	E,H
201030M007	7	Girls Bathroom by B-108 @ B-SK; Initial	1.00	4.98	µg/L	
201030M008	8	Girls Bathroom by B-108 @ C-SK; Initial	1.00	5.31	µg/L	
201030M009	9	Girls Bathroom by B-108 @ D-SK; Initial	1.00	7.15	µg/L	
201030M010	10	Staff Bathroom by B-106-SK; Initial	1.00	1.62	µg/L	
201030M011	11	Nurses Office -SK; Initial	1.00	<1.00	µg/L	
201030M012	12	Nurses Office Bathroom-SK; Initial	1.00	2.11	µg/L	
201030M013	13	Boys Bathroom by B-104 @ A-SK; Initial	1.00	2.62	µg/L	
201030M014	14	Boys Bathroom by B-104 @ B-SK; Initial	1.00	3.14	µg/L	
201030M015	15	B-102-SK; Initial	1.00	29.7	µg/L	H
201030M016	16	Hall by B-101 Bottle Filler-BF; Initial	1.00	<1.00	µg/L	
201030M017	17	B-101 Storage Room-SK; Initial	1.00	62.4	µg/L	E,H

Comment:

CID: Client ID LOQ: Limit of Quantitation

E: Sample result exceeds instrument calibration, value is estimated.

H: Sample result exceeds applicable regulatory limit.



**Laboratory Report**

NYE Report #: 2204339-16025

November 2, 2020

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: Valhalla CTE Campus- Building C

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on October 29, 2020. New York Environmental analyzed the samples on October 30, 2020 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	29 Oct 2020
Date Received:	29 Oct 2020
Date Analyzed:	30 Oct 2020

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
201029Q061	1	C-101 Cosmetology Lab-SK; Initial	1.00	4.21	µg/L	
201029Q062	2	Staff Bathroom by C-101-SK; Initial	1.00	3.43	µg/L	
201029Q063	3	C-102 Cosmetology Lab-SK; Initial	1.00	12.9	µg/L	
201029Q064	4	Hall by Courtyard Bottle Filler-BF; Initial	1.00	<1.00	µg/L	
201029Q065	5	Girls Bathroom by Courtyard @ A-SK; Initial	1.00	3.43	µg/L	
201029Q066	6	Girls Bathroom by Courtyard @ B-SK; Initial	1.00	2.31	µg/L	
201029Q067	7	Girls Bathroom by Courtyard @ C-SK; Initial	1.00	3.10	µg/L	
201029Q068	8	Girls Bathroom by Courtyard @ D-SK; Initial	1.00	12.2	µg/L	
201029Q069	9	Hall by C-204 Bottle Filler-BF; Initial	1.00	<1.00	µg/L	
201029Q070	10	C-204 EMS-SK; Initial	1.00	5.83	µg/L	
201029Q071	11	C-202-SK; Initial	1.00	3.30	µg/L	
201029Q072	12	Staff Lounge Kitchenette-SK; Initial	1.00	1.78	µg/L	
201029Q073	13	Womens Bathroom by C-201-SK; Initial	1.00	1.73	µg/L	
201029Q074	14	Mens Bathroom by C-201-SK; Initial	1.00	1.94	µg/L	
201029Q075	15	C-201 Cosmetology Lab-SK; Initial	1.00	4.94	µg/L	
201029Q076	16	C-203 Cosmetology Lab-SK; Initial	1.00	2.83	µg/L	
201029Q077	17	Girls Bathroom by C-203 @ A-SK; Initial	1.00	2.53	µg/L	
201029Q078	18	Girls Bathroom by C-203 @ B-SK; Initial	1.00	2.33	µg/L	
201029Q079	19	Girls Bathroom by C-203 @ C-SK; Initial	1.00	6.00	µg/L	
201029Q080	20	Girls Bathroom by C-203 @ D-SK; Initial	1.00	5.64	µg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation





**Laboratory Report**

NYE Report #: 2204340-16026

November 2, 2020

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: Valhalla CTE Campus- Building D

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on October 29, 2020. New York Environmental analyzed the samples on October 30, 2020 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	29 Oct 2020
Date Received:	29 Oct 2020
Date Analyzed:	30 Oct 2020

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
201029Q081	1	Mens Bathroom by Lobby @ A-SK; Initial	1.00	2.54	µg/L	
201029Q082	2	Mens Bathroom by Lobby @ B-SK; Initial	1.00	4.26	µg/L	
201029Q083	3	Womens Bathroom by Lobby @ A-SK; Initial	1.00	1.83	µg/L	
201029Q084	4	Womens Bathroom by Lobby @ B-SK; Initial	1.00	5.47	µg/L	
201029Q085	5	Hall by Lobby Bottle Filler-BF; Initial	1.00	<1.00	µg/L	
201029Q086	6	Mezzanine Kitchenette-SK; Initial	1.00	16.0	µg/L	H
201029Q087	7	D-202 Main Office Womens Bathroom-SK; Initial	1.00	1.45	µg/L	
201029Q088	8	D-202 Main Office Mens Bathroom-SK; Initial	1.00	2.52	µg/L	
201029Q089	9	D-204 Assistant Principal Kitchenette-SK; Initial	1.00	5.10	µg/L	
201029Q090	10	D-302 Study Hall-SK; Initial	1.00	<1.00	µg/L	
201029Q091	11	Girls Bathroom by D-302-SK; Initial	1.00	<1.00	µg/L	
201029Q092	12	Hall by D-302 Bottle Filler-BF; Initial	1.00	<1.00	µg/L	
201029Q093	13	D-303-SK; Initial	1.00	1.43	µg/L	
201029Q094	14	D-303-SPY; Initial	1.00	2.30	µg/L	
201029Q095	15	D-304-SK; Initial	1.00	47.0	µg/L	H
201029Q096	16	D-308-SK; Initial	1.00	1.84	µg/L	
201029Q097	17	D-308-SPY; Initial	1.00	<1.00	µg/L	
201029Q098	18	Boys Bathroom by Café @ A-SK; Initial	1.00	2.51	µg/L	
201029Q099	19	Boys Bathroom by Café @ B-SK; Initial	1.00	4.29	µg/L	
201029Q100	20	Girls Bathroom by Café @ A-SK; Initial	1.00	1.53	µg/L	
201029Q101	21	Girls Bathroom by Café @ B-SK; Initial	1.00	4.06	µg/L	
201029Q102	22	D-101 Life Skills Room-SK; Initial	1.00	3.36	µg/L	
201029Q103	23	D-101 Life Skills Room-SPY; Initial	1.00	<1.00	µg/L	
201029Q104	24	D-101 Life Skills Room-SS; Initial	1.00	5.41	µg/L	
201029Q105	25	D-101 Life Skills Room Bathroom-SK; Initial	1.00	2.82	µg/L	
201029Q106	26	D-103 Café Kitchen 2 Bay-SK; Initial	1.00	1.04	µg/L	



Date Collected:	29 Oct 2020
Date Received:	29 Oct 2020
Date Analyzed:	30 Oct 2020

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
201029Q107	27	D-103 Café Kitchen 3 Bay-SPY; Initial	1.00	<1.00	µg/L	
201029Q108	28	D-103 Café Kitchen 3 Bay-SK; Initial	1.00	2.25	µg/L	
201029Q109	29	D-103 Café Kitchen-IM; Initial	1.00	<1.00	µg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

**Laboratory Report**

NYE Report #: 2204348-16034

November 2, 2020

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: Valhalla CTE Campus- Building E

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on October 30, 2020. New York Environmental analyzed the samples on October 31, 2020 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	29 Oct 2020
Date Received:	30 Oct 2020
Date Analyzed:	31 Oct 2020

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
201030M039	1	Room E202 Bathroom @A-SK; Initial	1.00	5.50	µg/L	
201030M040	2	Room E202 Bathroom @B-SK; Initial	1.00	9.57	µg/L	
201030M041	3	Room E201 Bathroom @A-SK; Initial	1.00	6.21	µg/L	
201030M042	4	Room E201 Bathroom @B-SK; Initial	1.00	11.3	µg/L	
201030M043	5	Room E102 Bathroom-SK; Initial	1.00	6.29	µg/L	
201030M044	6	Hallway between Room E101 & E102-BF; Initial	1.00	<1.00	µg/L	
201030M045	7	Boys Bathroom @A between Room E101 & E102-SK; Initial	1.00	3.73	µg/L	
201030M046	8	Boys Bathroom @B between Room E101 & E102-SK; Initial	1.00	56.2	µg/L	E,H

Comment:

CID: Client ID LOQ: Limit of Quantitation

E: Sample result exceeds instrument calibration, value is estimated.

H: Sample result exceeds applicable regulatory limit.



## Laboratory Report

NYE Report #: 2204347-16033

November 2, 2020

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: Valhalla CTE Campus- Building I

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on October 30, 2020. New York Environmental analyzed the samples on October 31, 2020 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,

A handwritten signature in black ink, appearing to read 'Li Tsang', is written over a horizontal line.

Li Tsang, Laboratory Director

Date Collected:	29 Oct 2020
Date Received:	30 Oct 2020
Date Analyzed:	31 Oct 2020

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
201030M018	1	I-101 Culinary Arts II Dishwash Station-SK; Initial	1.00	<1.00	µg/L	
201030M019	2	I-101 Culinary Arts II 2 Bay-SK; Initial	1.00	<1.00	µg/L	
201030M020	3	I-101 Culinary Arts II 3 Bay-SK; Initial	1.00	2.84	µg/L	
201030M021	4	Womens Bathroom by I-101-SK; Initial	1.00	<1.00	µg/L	
201030M022	5	Mens Bathroom by I-101-SK; Initial	1.00	<1.00	µg/L	
201030M023	6	I-102 Culinary Arts I Island-SK; Initial	1.00	3.77	µg/L	
201030M024	7	I-102 Culinary Arts I Pot Filler-SP; Initial	1.00	<1.00	µg/L	
201030M025	8	I-102 Culinary Arts I Dishwash Station-SPY; Initial	1.00	<1.00	µg/L	
201030M026	9	I-102 Culinary Arts I 3 Bay @ A-SK; Initial	1.00	1.54	µg/L	
201030M027	10	I-102 Culinary Arts I 3 Bay @ B-SK; Initial	1.00	2.05	µg/L	
201030M028	11	I-102 Culinary Arts I 2 Bay-SK; Initial	1.00	1.33	µg/L	
201030M029	12	I-102 Culinary Arts I -IM; Initial	1.00	<1.00	µg/L	
201030M030	13	I-104 Auto Trades Bathroom-SK; Initial	1.00	1.92	µg/L	
201030M031	14	I-104 Auto Trades-SS; Initial	1.00	<1.00	µg/L	
201030M032	15	I-105 Auto Trades Bathroom-SK; Initial	1.00	3.36	µg/L	
201030M033	16	Womens Bathroom by I-109-SK; Initial	1.00	<1.00	µg/L	
201030M034	17	Mens Bathroom by I-109-SK; Initial	1.00	<1.00	µg/L	
201030M035	18	Hall by I-109 Bottle Filler-BF; Initial	1.00	<1.00	µg/L	
201030M036	19	I-110 Auto Service Bathroom-SK; Initial	1.00	<1.00	µg/L	
201030M037	20	I-111 Auto Service Bathroom-SK; Initial	1.00	<1.00	µg/L	
201030M038	21	I-111 Auto Service-SS; Initial	1.00	2.51	µg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

